


POWER PLAN NOTES:

- ① E.C. SHALL REUSE EXISTING WIRING DEVICES CIRCUITS TO FEED NEW DUPLEX OUTLETS, AND SPECIAL EQUIPMENT. SHOULD ADDITIONAL CIRCUITS BE REQUIRED, E.C. SHALL PROVIDE NEW CIRCUITS FROM THE NEAREST ELECTRICAL PANEL WITH ADEQUATE SPACE FOR NEW CIRCUITS.
- ② E.C. SHALL FEED NEW KITCHEN EQUIPMENT FROM NEW PANEL 'K'. COORDINATE WITH KITCHEN EQUIPMENT INSTALLER FOR THE COMPLETE AND ACCURATE INSTALLATION AND FINAL ELECTRICAL CONNECTIONS TO ALL NEW KITCHEN EQUIPMENT. REFER TO PANEL 'K' PANEL SCHEDULE ON DRAWING E-104 FOR REQUIRED CIRCUITRY.
- ③ E.C. TO REFER TO KITCHEN EQUIPMENT SCHEDULE ON DRAWING E-104 FOR ELECTRICAL REQUIREMENTS FOR NEW KITCHEN EQUIPMENT.
- ④ E.C. SHALL INSTALL NEW ELECTRICAL SERVICE EQUIPMENT FOR BUILDING. REFER TO RISER DIAGRAM ON DRAWING E-104 FOR MORE INFORMATION.
- ⑤ E.C. SHALL PROVIDE (1) 4" SQUARE FLUSH MOUNTED JUNCTION BOX AND (1) 1" CONDUIT DROP AT EACH JUNCTION BOX LOCATION FOR VOICE/DATA CABLING. CONDUITS TO HAVE INSULATED BUSHING INSTALLED FOR CABLE PROTECTION. VOICE/DATA SYSTEM BY OTHERS. FIELD VERIFY LOCATIONS OF VOICE/DATA JUNCTION BOXES. PROVIDE ALL REQUIRED LABOR & MATERIALS FOR A COMPLETE & ACCURATE INSTALLATION. E.C. TO PROVIDE (1) DUPLEX OUTLET AT EACH P.O.S. LOCATION. WIRE OUTLETS TO CKT. K-48. FIELD VERIFY EXACT LOCATIONS OF OUTLETS. PROVIDE ALL REQUIRED LABOR & MATERIALS FOR A COMPLETE & ACCURATE INSTALLATION.
- ⑥ E.C. SHALL PROVIDE (1) 20A/1P CIRCUIT BREAKER IN EXISTING ELECTRICAL PANEL AT THE TOP OF STAIRWAY TO POWER BUILDINGS NEW SECURITY SYSTEM. PROVIDE 20 AMP CIRCUIT AT EACH JUNCTION BOX INDICATED. SECURITY SYSTEM BY OTHERS.
- ⑦ E.C. SHALL PROVIDE (1) 20A/1P CIRCUIT BREAKER IN EXISTING PANEL AT TOP OF STAIRS FOR POWERING BUILDINGS NEW FIRE ALARM SYSTEM. FIELD VERIFY EXACT LOCATION OF FIRE ALARM CONTROL PANEL. FIRE ALARM SYSTEM BY OTHERS. NEW FIRE ALARM SYSTEM SHALL BE CONNECTED TO ANSUL SYSTEM IN NEW KITCHEN EXHAUST HOODS.
- ⑧ E.C. SHALL PROVIDE (1) 4" SQUARE FLUSH MOUNTED JUNCTION BOX AND (1) 1" CONDUIT DROP AT EACH JUNCTION BOX LOCATION FOR VOICE/DATA CABLING. CONDUITS TO HAVE INSULATED BUSHING INSTALLED FOR CABLE PROTECTION. VOICE/DATA SYSTEM BY OTHERS. FIELD VERIFY LOCATIONS OF VOICE/DATA JUNCTION BOXES. PROVIDE ALL REQUIRED LABOR & MATERIALS FOR A COMPLETE & ACCURATE INSTALLATION.

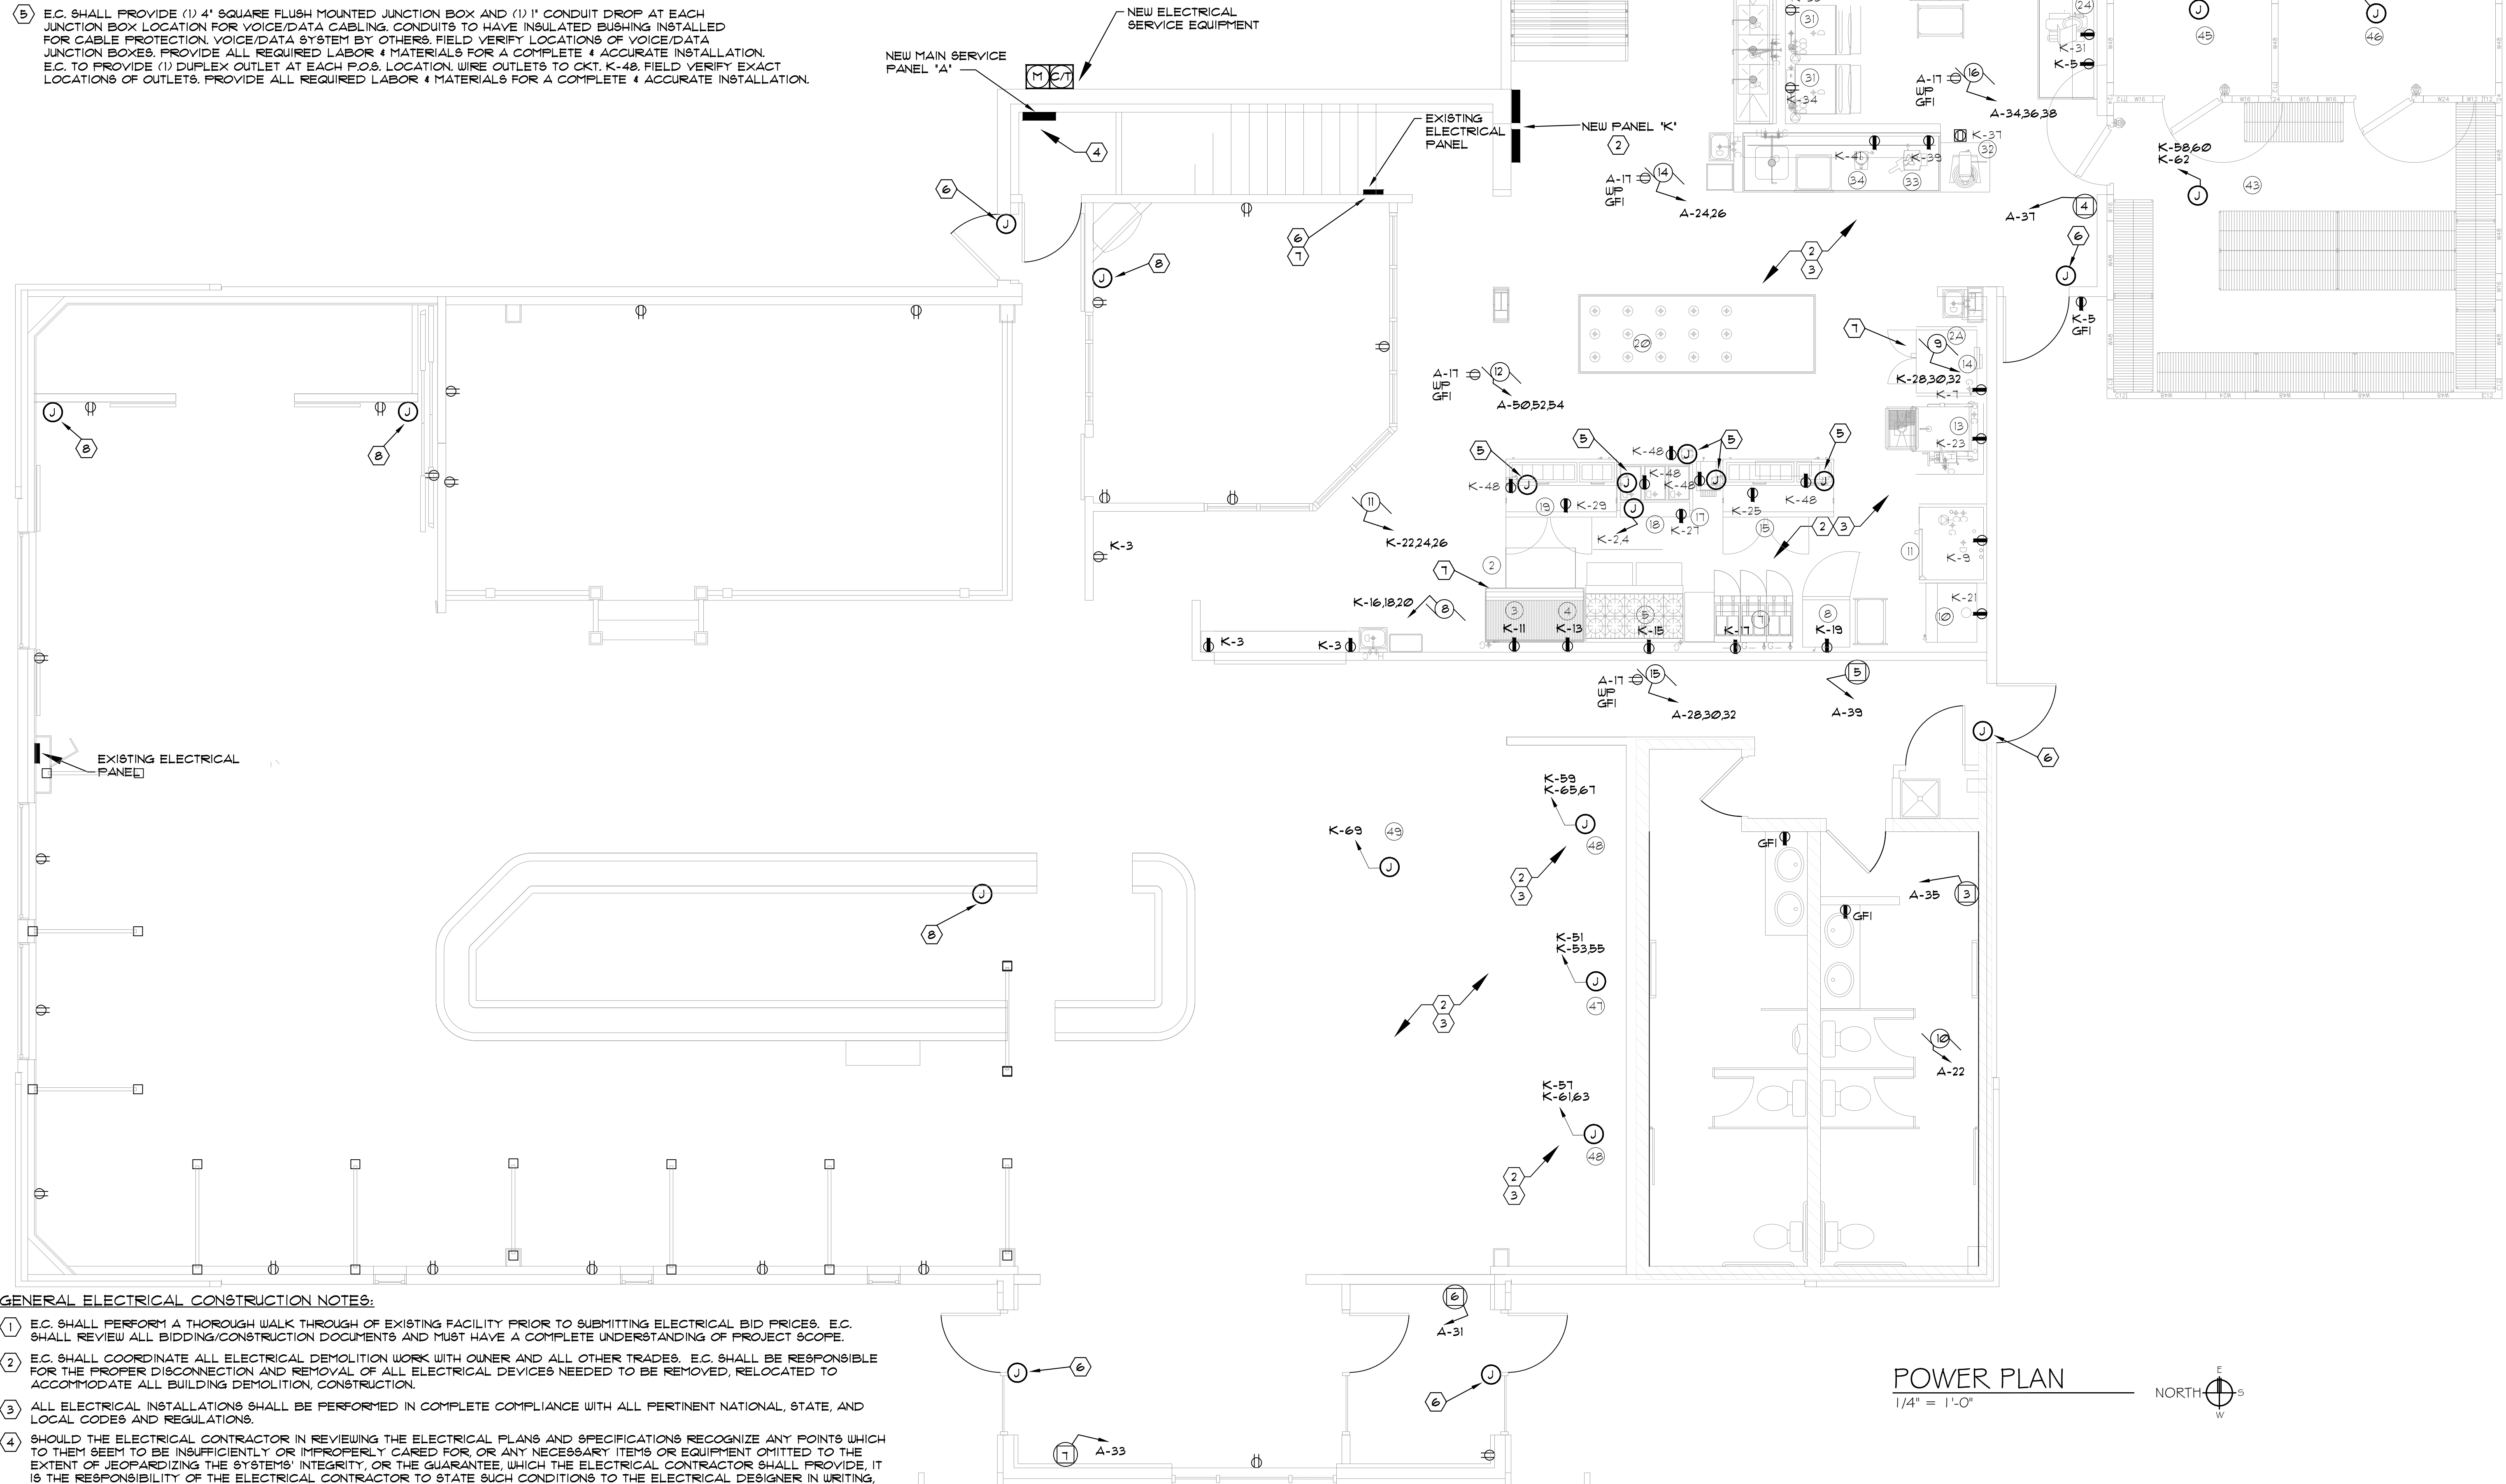

GENERAL ELECTRICAL CONSTRUCTION NOTES:

- ① E.C. SHALL PERFORM A THOROUGH WALK THROUGH OF EXISTING FACILITY PRIOR TO SUBMITTING ELECTRICAL BID PRICES. E.C. SHALL REVIEW ALL BIDDING/CONSTRUCTION DOCUMENTS AND MUST HAVE A COMPLETE UNDERSTANDING OF PROJECT SCOPE.
- ② E.C. SHALL COORDINATE ALL ELECTRICAL DEMOLITION WORK WITH OWNER AND ALL OTHER TRADES. E.C. SHALL BE RESPONSIBLE FOR THE PROPER DISCONNECTION AND REMOVAL OF ALL ELECTRICAL DEVICES NEEDED TO BE REMOVED, RELOCATED TO ACCOMMODATE ALL BUILDING DEMOLITION, CONSTRUCTION.
- ③ ALL ELECTRICAL INSTALLATIONS SHALL BE PERFORMED IN COMPLETE COMPLIANCE WITH ALL PERTINENT NATIONAL, STATE, AND LOCAL CODES AND REGULATIONS.
- ④ SHOULD THE ELECTRICAL CONTRACTOR IN REVIEWING THE ELECTRICAL PLANS AND SPECIFICATIONS RECOGNIZE ANY POINTS WHICH TO THEM SEEM TO BE INSUFFICIENTLY OR IMPROPERLY CARED FOR, OR ANY NECESSARY ITEMS OR EQUIPMENT OMITTED TO THE EXTENT OF JEOPARDIZING THE SYSTEMS' INTEGRITY, OR THE GUARANTEE, WHICH THE ELECTRICAL CONTRACTOR SHALL PROVIDE, IT IS THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR TO STATE SUCH CONDITIONS TO THE ELECTRICAL DESIGNER IN WRITING, DURING THE BID PROCESS, SO SUCH ITEMS CAN BE ADDRESSED DURING THE BID PROCESS. IF THIS CONDITION IS NOT COMPLIED WITH, IT WILL BE ASSUMED THAT THE ELECTRICAL SYSTEMS COVERED IN THESE DOCUMENTS ARE SATISFACTORY TO THE CONTRACTOR AND THEY SHALL BE HELD BOUND TO THEIR GUARANTEE.

Verify all existing site conditions
REVISIONS:

SHEET INDEX: ELECTRICAL POWER PLAN		
Copyright © 2018 Ideas House, Inc.	DRAWN KLP	APPROVED BEC
APRIL 24, 2018		